



- > INSTALL NEW AIR HANDLING UNIT #1. SEE COIL PIPING DIAGRAM.
- > INSTALL NEW AIR COOLED CHILLER (CH-1) WITH CONCRETE PAD. SEE PIPING DIAGRAM.
- > ROUTE NEW CHILLED WATER PIPING ABOVE GROUND TO BOILER ROOM. PROVIDE SUPPORTS
- > ROUTE NEW CHILLED WATER PIPING 15' ABOVE FLOOR TO AHU-1, ST-1 AND CHWP-1
- > ROUTE NEW HOT WATER PIPING 15' ABOVE FLOOR TO B-1, HWP-1 AND AHU-1.
- > CONNECT NEW HOT WATER PIPING TO EXISTING HOT WATER PIPING.
- > INSTALL NEW BOILER WITH FLUE THROUGH THE ROOF. EXISINTING ROOF PENETRATION WILL HAVE TO BE ENLARGED FOR NEW FLUE.
- > INSTALL NEW CHILLED WATER PUMP (CHWP-1).
- > INSTALL NEW HOT WATER PUMP (HWP-1).
- > PROVIDE PIPING STRAPS TO WALL.

CONDENSING UNIT MODEL NO. ETHN-2
SERIAL NO. G96-6673.

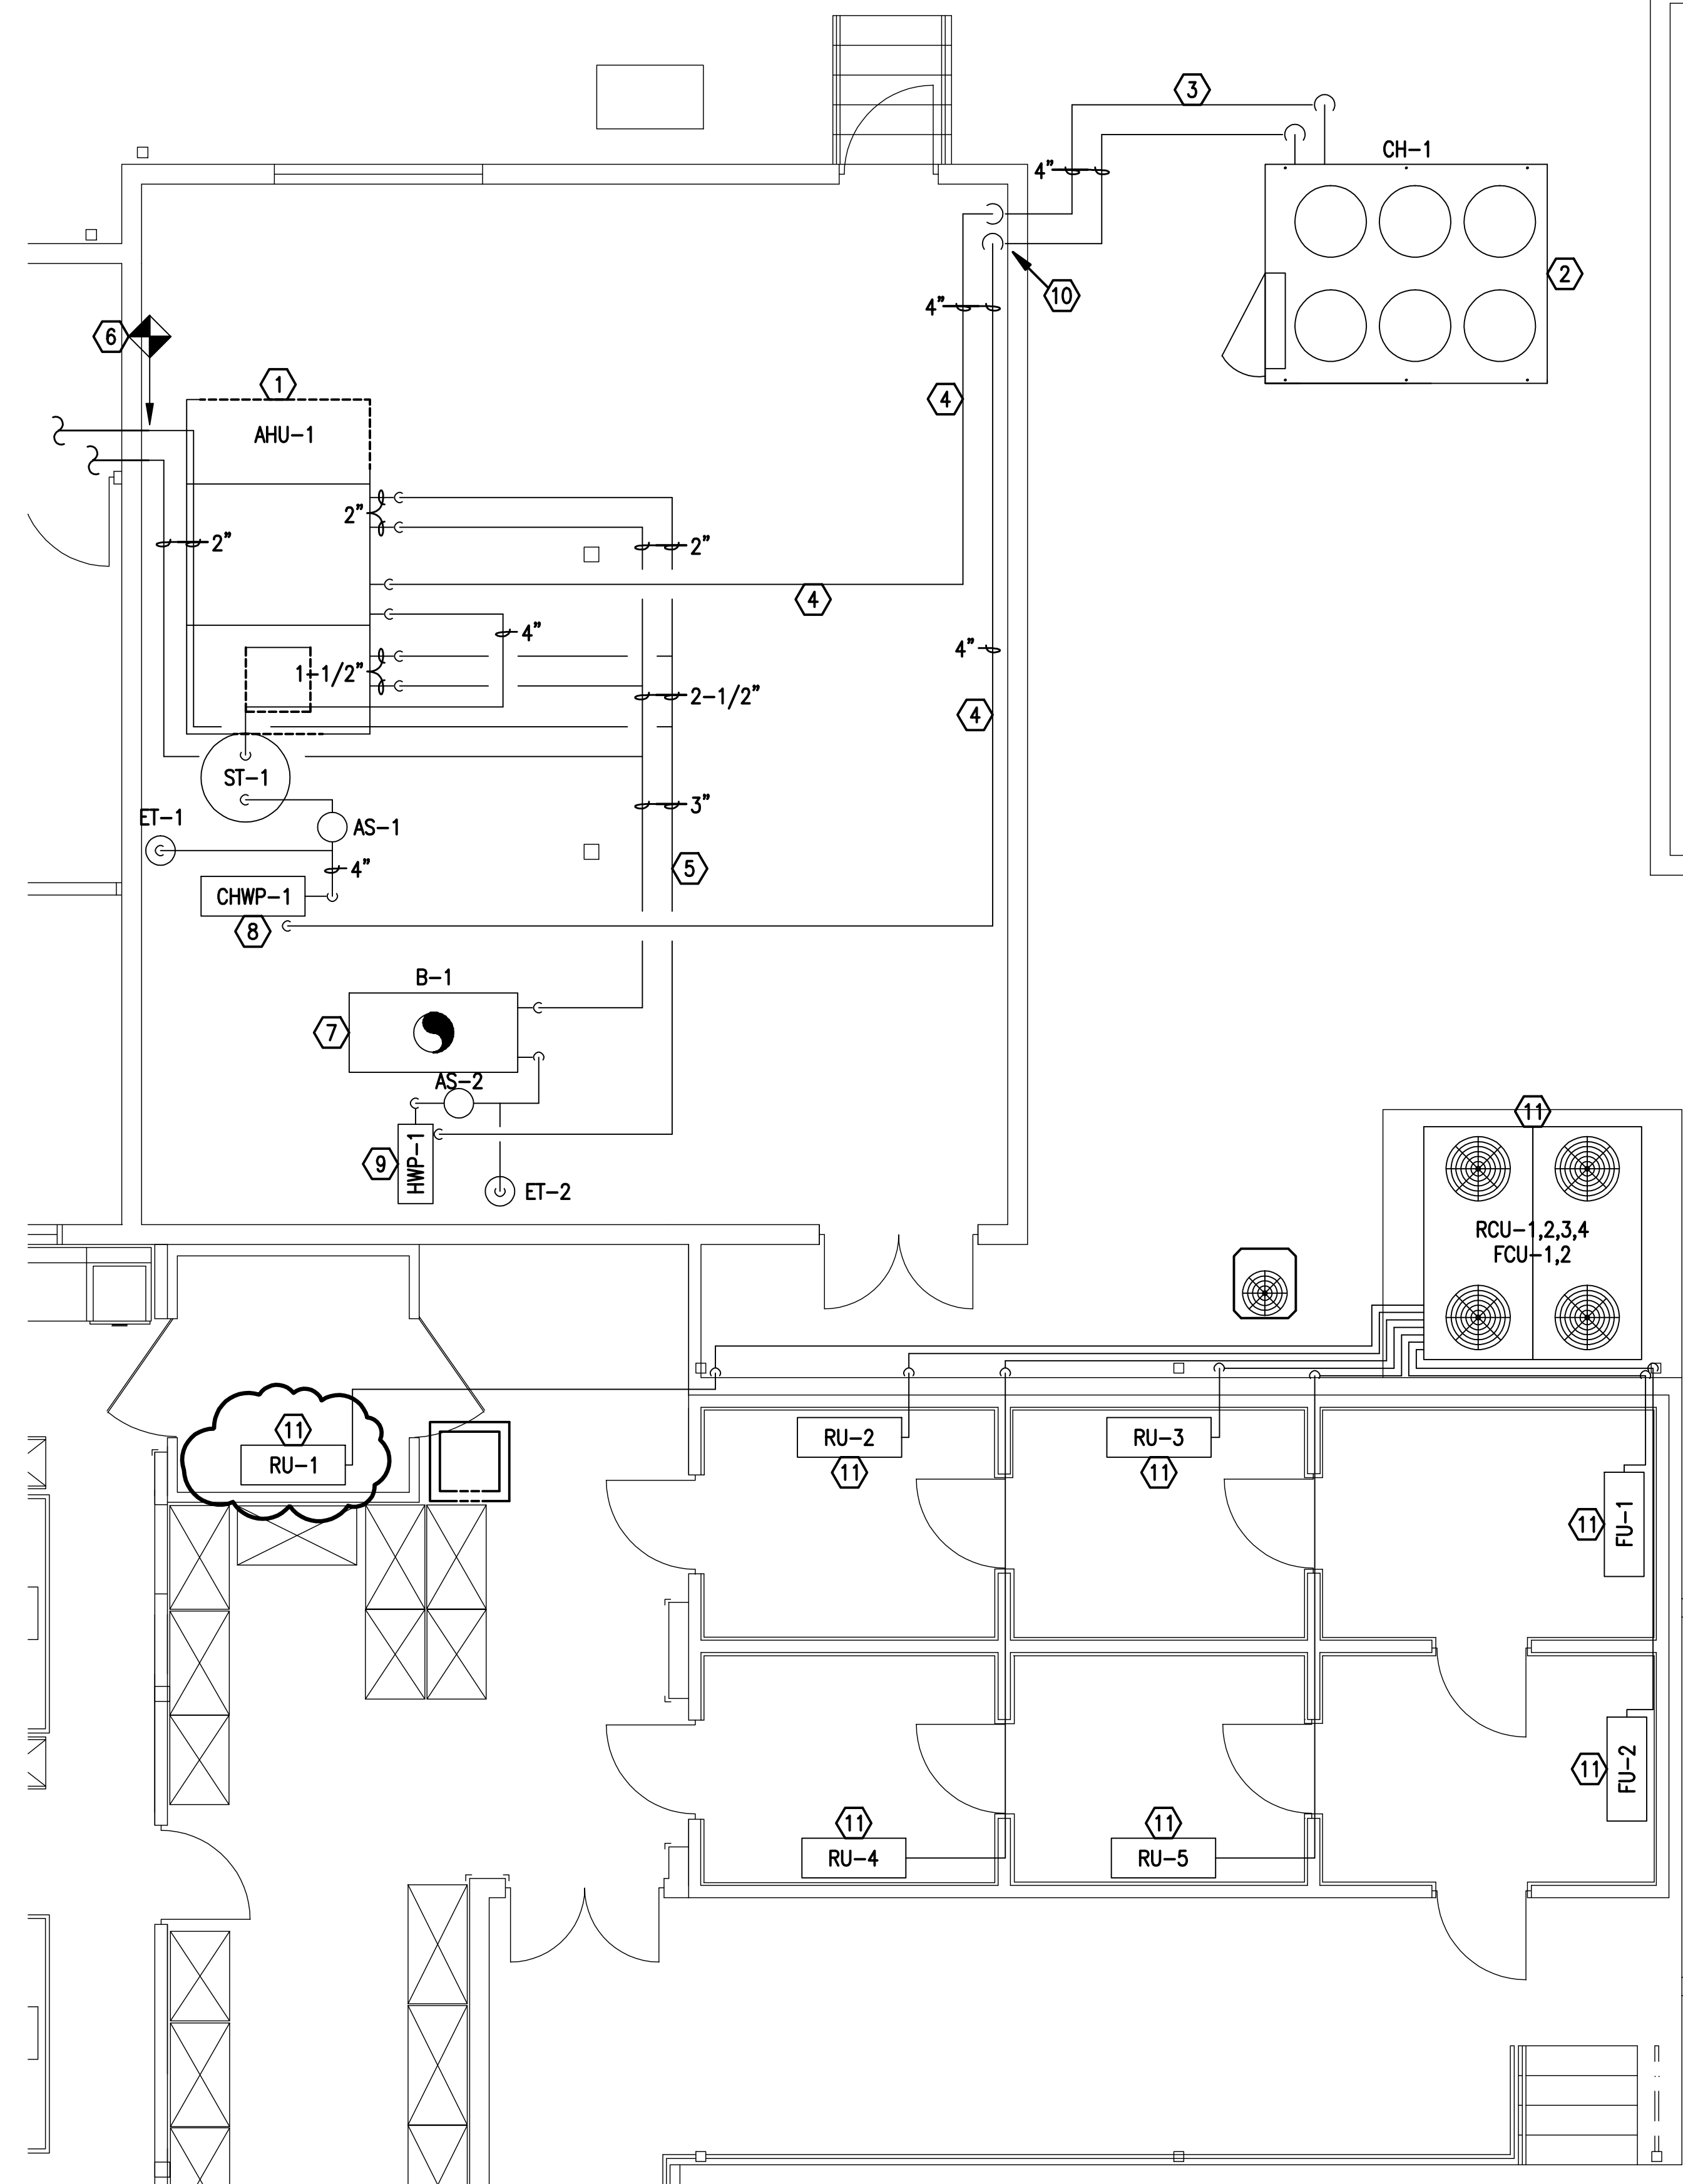

 HVAC PIPING PLAN — NEW WORK
SCALE: 1/4"=1'-0"

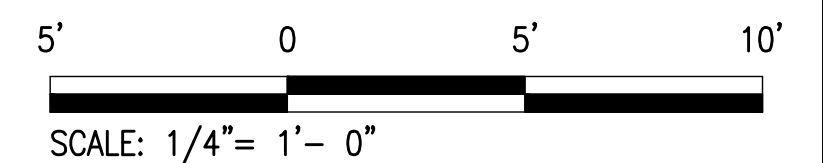

PETERSON ENGINEERING INC.
(PROF. ENG. # 3600)
75 SOUTH "F" STREET
PENSACOLA, FLORIDA 32502
(850) 434-0513
P.E.I. JOB# 08123

[illegible]